



Republic of the Philippines  
CIVIL AVIATION AUTHORITY OF THE PHILIPPINES

SUPPLEMENTAL / BID BULLETIN No. 1  
PURCHASE/INSTALLATION OF PAPI 04 SYSTEM AND OTHER WORKS AT BUKIDNON  
AIRPORT  
(Bid No. 25-42-07 ALPHA)  
18 July 2025

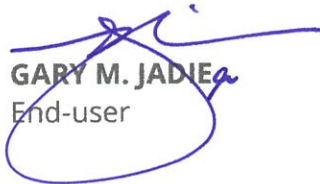
I. Clarifications to Queries from Prospective Bidder/s.

Item	Particulars	End-user Response
BOQ/ Page 60 Item II. Site Works / Delivery	<p>1. <i>If there is conflict between the BOQ and drawings, please confirm that specified BOQ quantity will prevail should there be discrepancy in required quantity.</i></p> <p>2. <i>In relation to our first query, Under Item II.1 of the Bill of Quantities, Excavation Works for Cable run with Lx0.3mx0.6m is specified. The drawings indicate multiple conduits to be installed in one trench and 0.3 m width of excavation will not be enough. Likewise, there is no available standard backhoe bucket that can perform excavation with a width as narrow as 0.3 meters and to perform required length of trench to be done given the limited number of hours per day, wider excavation will be required. This will result in a significantly higher volume of excavation (cu.m) than what is provided in the BOQ. Consequently, the specified quantity (cu.m) of Backfilling Works and Sand bedding (cu.m) in the BOQ will also significantly increase. Please clarify on how to go about the difference with specified quantity in the BOQ.</i></p>	<p>The BOQ shall prevail for bid preparation. The drawings remain for reference to define the scope and execution.</p> <p>It has been observed that the excavation quantity shown in the construction drawings slightly exceeds the quantity indicated in the Bill of Quantities (BOQ).</p> <p>Upon evaluation by the end-user, the variance amounts do not significantly affect the total project cost.</p> <p>To ensure clarity and uniform interpretation, please be guided as follows:</p> <ol style="list-style-type: none"><li>1. The BOQ shall prevail for purposes of bid preparation, submission, and evaluation</li><li>2. Bidders are instructed to consider the drawings for guidance, but the BOQ controls for bid pricing.</li><li>3. Any change in quantity due to design revisions or future needs may be addressed through a variation order, subject to the provision given</li></ol>


BOQ/Page 60 Underground Cable Ducts, manholes, handholes, grounding	3. <i>The Warning Tape in the drawings is 150mm but in the BOQ it is 3". Please clarify the required warning tape.</i>	in the revised IRR Annex E of RA 9184, which may result in either an increase or decrease in total cost.  Prospective bidder/s may use the 3" x 1000' warning tape size as stated in the BOQ (3"x1000', similar or better).
--	--	---

This bid bulletin shall be an integral part of the Bidding Documents and the same shall be enclosed in the technical bid envelope/component and shall be marked/tapped accordingly.

For the information and guidance of all concerned.

  
**GARY M. JADIE**  
End-user

Approved by:

  
**ATTY. ROBERTO MARTIN S. BUENAVENTURA**  
Chairperson, BAC-ALPHA